



MaxiForce Round Removable and Fixed Steel Bollard Installation Schedule
Per American Association of State Highway and Transportation Officials (AASHTO) Section 2.7

| Engineered Anchorage System for MaxiForce Round Removable and Fixed Steel Bollards per American Association of State Highway and Transportation Officials (AASHTO) Section 2.7 | | | | | | | | | | |
|---|--|-----------------------|---------------------------------|-------------------------------|------------------------------|--|------------------------------------|------------------------------------|---------------------------------|----------------|
| MRHD / HDH or MFR Size | Bollard Ultimate Load / Max. Capacity | Design Load (lbs.) | Concrete Pier Diameter (in.) | Concrete Pier Height (in.) | Concrete Pier Reinforcing | Bollard Sleeve / Embedment at Concrete Pier | Concrete Grade Beam Depth (In.) | Concrete Grade Beam Width (In.) | Concrete Grade Beam Reinforcing | |
| | | | | | | | | | Longitudinal | Stirrups |
| | | | Individual Footing Option | | | | Continuous Footing Option | | | |
| 3" | 3,185 | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| 4" (5.0) | 5,945 | 3,333 | 16 | 53 | 4 - #4 vert. | 18" Sleeve / 18" Embedment | 26 | 12 | 4 - #4 cont. | #3 at 11" o.c. |
| 4" (1.0) | 5,945 | 5,000 | 16 | 60 | 4 - #5 vert. | 18" Sleeve / 18" Embedment | 28 | 12 | 4 - #4 cont. | #3 at 12" o.c. |
| 4" (1.0) | 5,945 | 5,000 | 18 | 57 | 4 - #5 vert. | 18" Sleeve / 18" Embedment | 24 | 16 | 4 - #4 cont. | #3 at 10" o.c. |
| 5" | 10,093 | 10,000 | 16 | 72 | 6 - #5 vert. | 18" Sleeve / 18" Embedment | 30 | 16 | 4 - #4 cont. | #3 at 11" o.c. |
| 5" | 10,093 | 10,000 | 18 | 72 | 6 - #5 vert. | 18" Sleeve / 18" Embedment | 28 | 18 | 4 - #4 cont. | #3 at 9" o.c. |
| 6" | 18,769 | 10,000 | 16 | 72 | 6 - #5 vert. | 18" Sleeve / 18" Embedment | 30 | 16 | 4 - #4 cont. | #3 at 11" o.c. |
| 6" | 18,769 | 10,000 | 18 | 72 | 6 - #5 vert. | 18" Sleeve / 18" Embedment | 28 | 18 | 4 - #4 cont. | #3 at 9" o.c. |
| 8" | 36,246 | 10,000 | 16 | 72 | 6 - #5 vert. | 18" Sleeve / 18" Embedment | 30 | 16 | 4 - #4 cont. | #3 at 11" o.c. |
| 8" | 36,246 | 10,000 | 18 | 72 | 6 - #5 vert. | 18" Sleeve / 18" Embedment | 28 | 18 | 4 - #4 cont. | #3 at 9" o.c. |

Design and Construction Notes:

- 1.0 Two (2) bollard array required to meet AASHTO section 2.7. Minimum of 2 bollards shall engage the vehicle in a vehicle barrier design. Maximum bollard spacing at 3'-0" o.c.
- 2.0 Allowable Foundation Pressure = 2,000 psf. Allowable Lateral Bearing = 150/psf. Assumed in-place soil: Sand, Silty Sand, Clayey Sand, Silty Gravel, or Clayey Gravel. For higher soil allowable design values, site soil investigation by a Registered Geotechnical Engineer is required.
- 3.0 See supplemental concrete pier / beam details for additional information.
- 4.0 Material Specifications: Concrete = 3,000 psi (28-day min.); Reinforcing ASTM A615 (60 ksi for all bars #5 and larger/ 40 ksi for all bars #4 and smaller).
- 5.0 Three (3) bollard array required to meet AASHTO section 2.7. Minimum of 3 bollards shall engage the vehicle in a vehicle barrier design. Maximum bollard spacing at 2'-0" o.c.
- 6.0 For continuous footing option, maximum single bollard spacing at 4'-0' o.c.

Drawing Rev.
2

Created
11/19/2020

PROPRIETARY AND CONFIDENTIAL

THIS DRAWING CONTAINS PROPRIETARY INFORMATION OF BLUE EMBER TECHNOLOGIES, LLC. ANY USE OF THIS DRAWING OR THE INFORMATION CONTAINED HEREIN FOR OTHER THAN THE PURPOSE FOR WHICH THIS DRAWING IS FURNISHED IS FORBIDDEN.

MaxiForce

7560 Main Street
Sykesville, MD 21784
tel: +1 (410) 552 9888
sales@maxiforcebollards.com
www.maxiforcebollards.com


MaxiForce Bollards

Title
HD/HDH & MFR Inst Sched (AASHTO 2.7)


C

DO NOT SCALE DRAWING

SHEET 1 OF 1





Engineered Anchorage System for the MaxiForce HD and HDH Base Circular Concrete Pier Footing

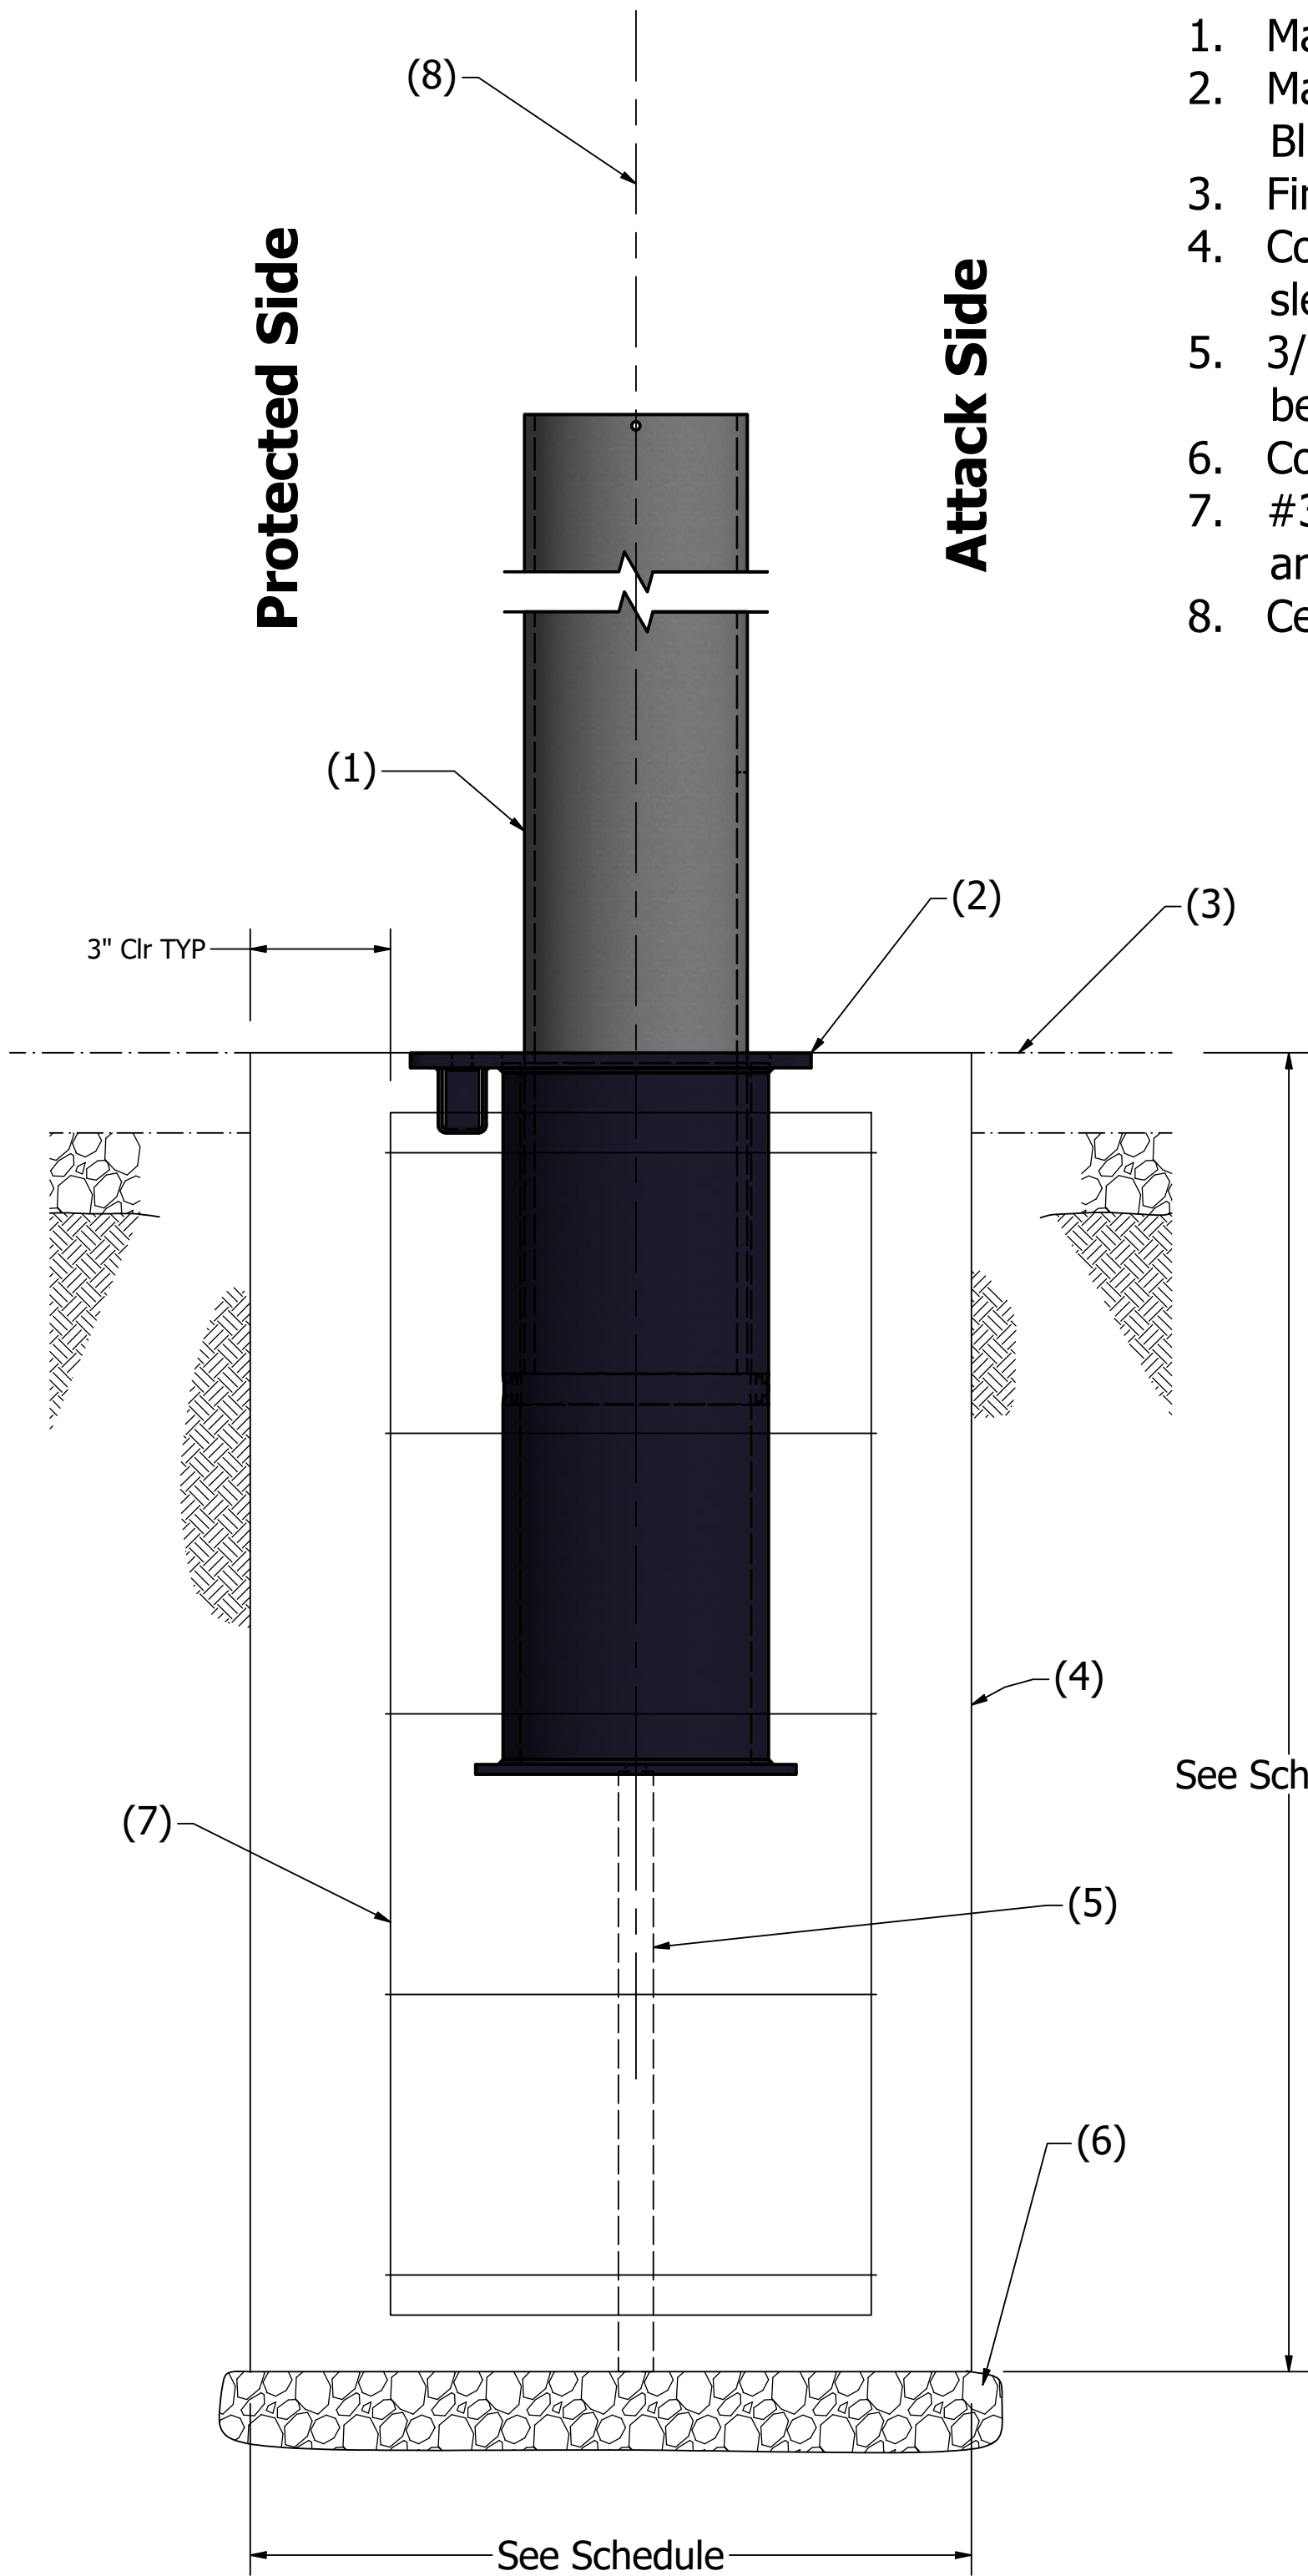

1. MaxiForce Steel pipe bollard per specification.
2. MaxiForce HD or HDH Base assembly per Blue Ember Technologies.
3. Finished grade or pavement.
4. Concrete base pier per schedule at each pipe sleeve.
5. 3/4" Dia. PVC pipe as needed for drainage below pipe sleeve.
6. Compacted gravel bed (3" minimum).
7. #3 hoop ties at 12" O.C. and 2 - #3 ties at top and bottom of concrete pier.
8. Centerline of bollard and concrete base pier.


Installation Orientation

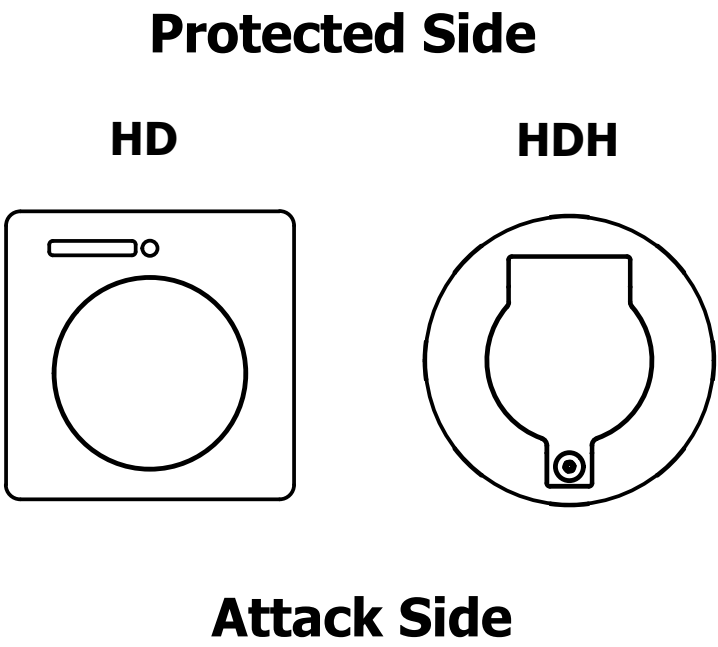

| | | | |
|---|-----------------------|--|----------------------|
| Drawing Rev. 1 | Created 11/18/2020 | <div>MaxiForce</div> <div>7560 Main Street Sykesville, MD 21784 tel: +1 (410) 552 9888 sales@maxiforcebollards.com www.maxiforcebollards.com</div> <div><div>MaxiForce Bollards</div></div> | |
| <div>PROPRIETARY AND CONFIDENTIAL</div> <div>THIS DRAWING CONTAINS PROPRIETARY INFORMATION OF BLUE EMBER TECHNOLOGIES, LLC. ANY USE OF THIS DRAWING OR THE INFORMATION CONTAINED HEREIN FOR OTHER THAN THE PURPOSE FOR WHICH THIS DRAWING IS FURNISHED IS FORBIDDEN.</div> | | Title HD/HDH Base Pier Footing | |
| | | C | DO NOT SCALE DRAWING |




Engineered Anchorage System for the MaxiForce HD and HDH Base Continuous Concrete Beam Footing

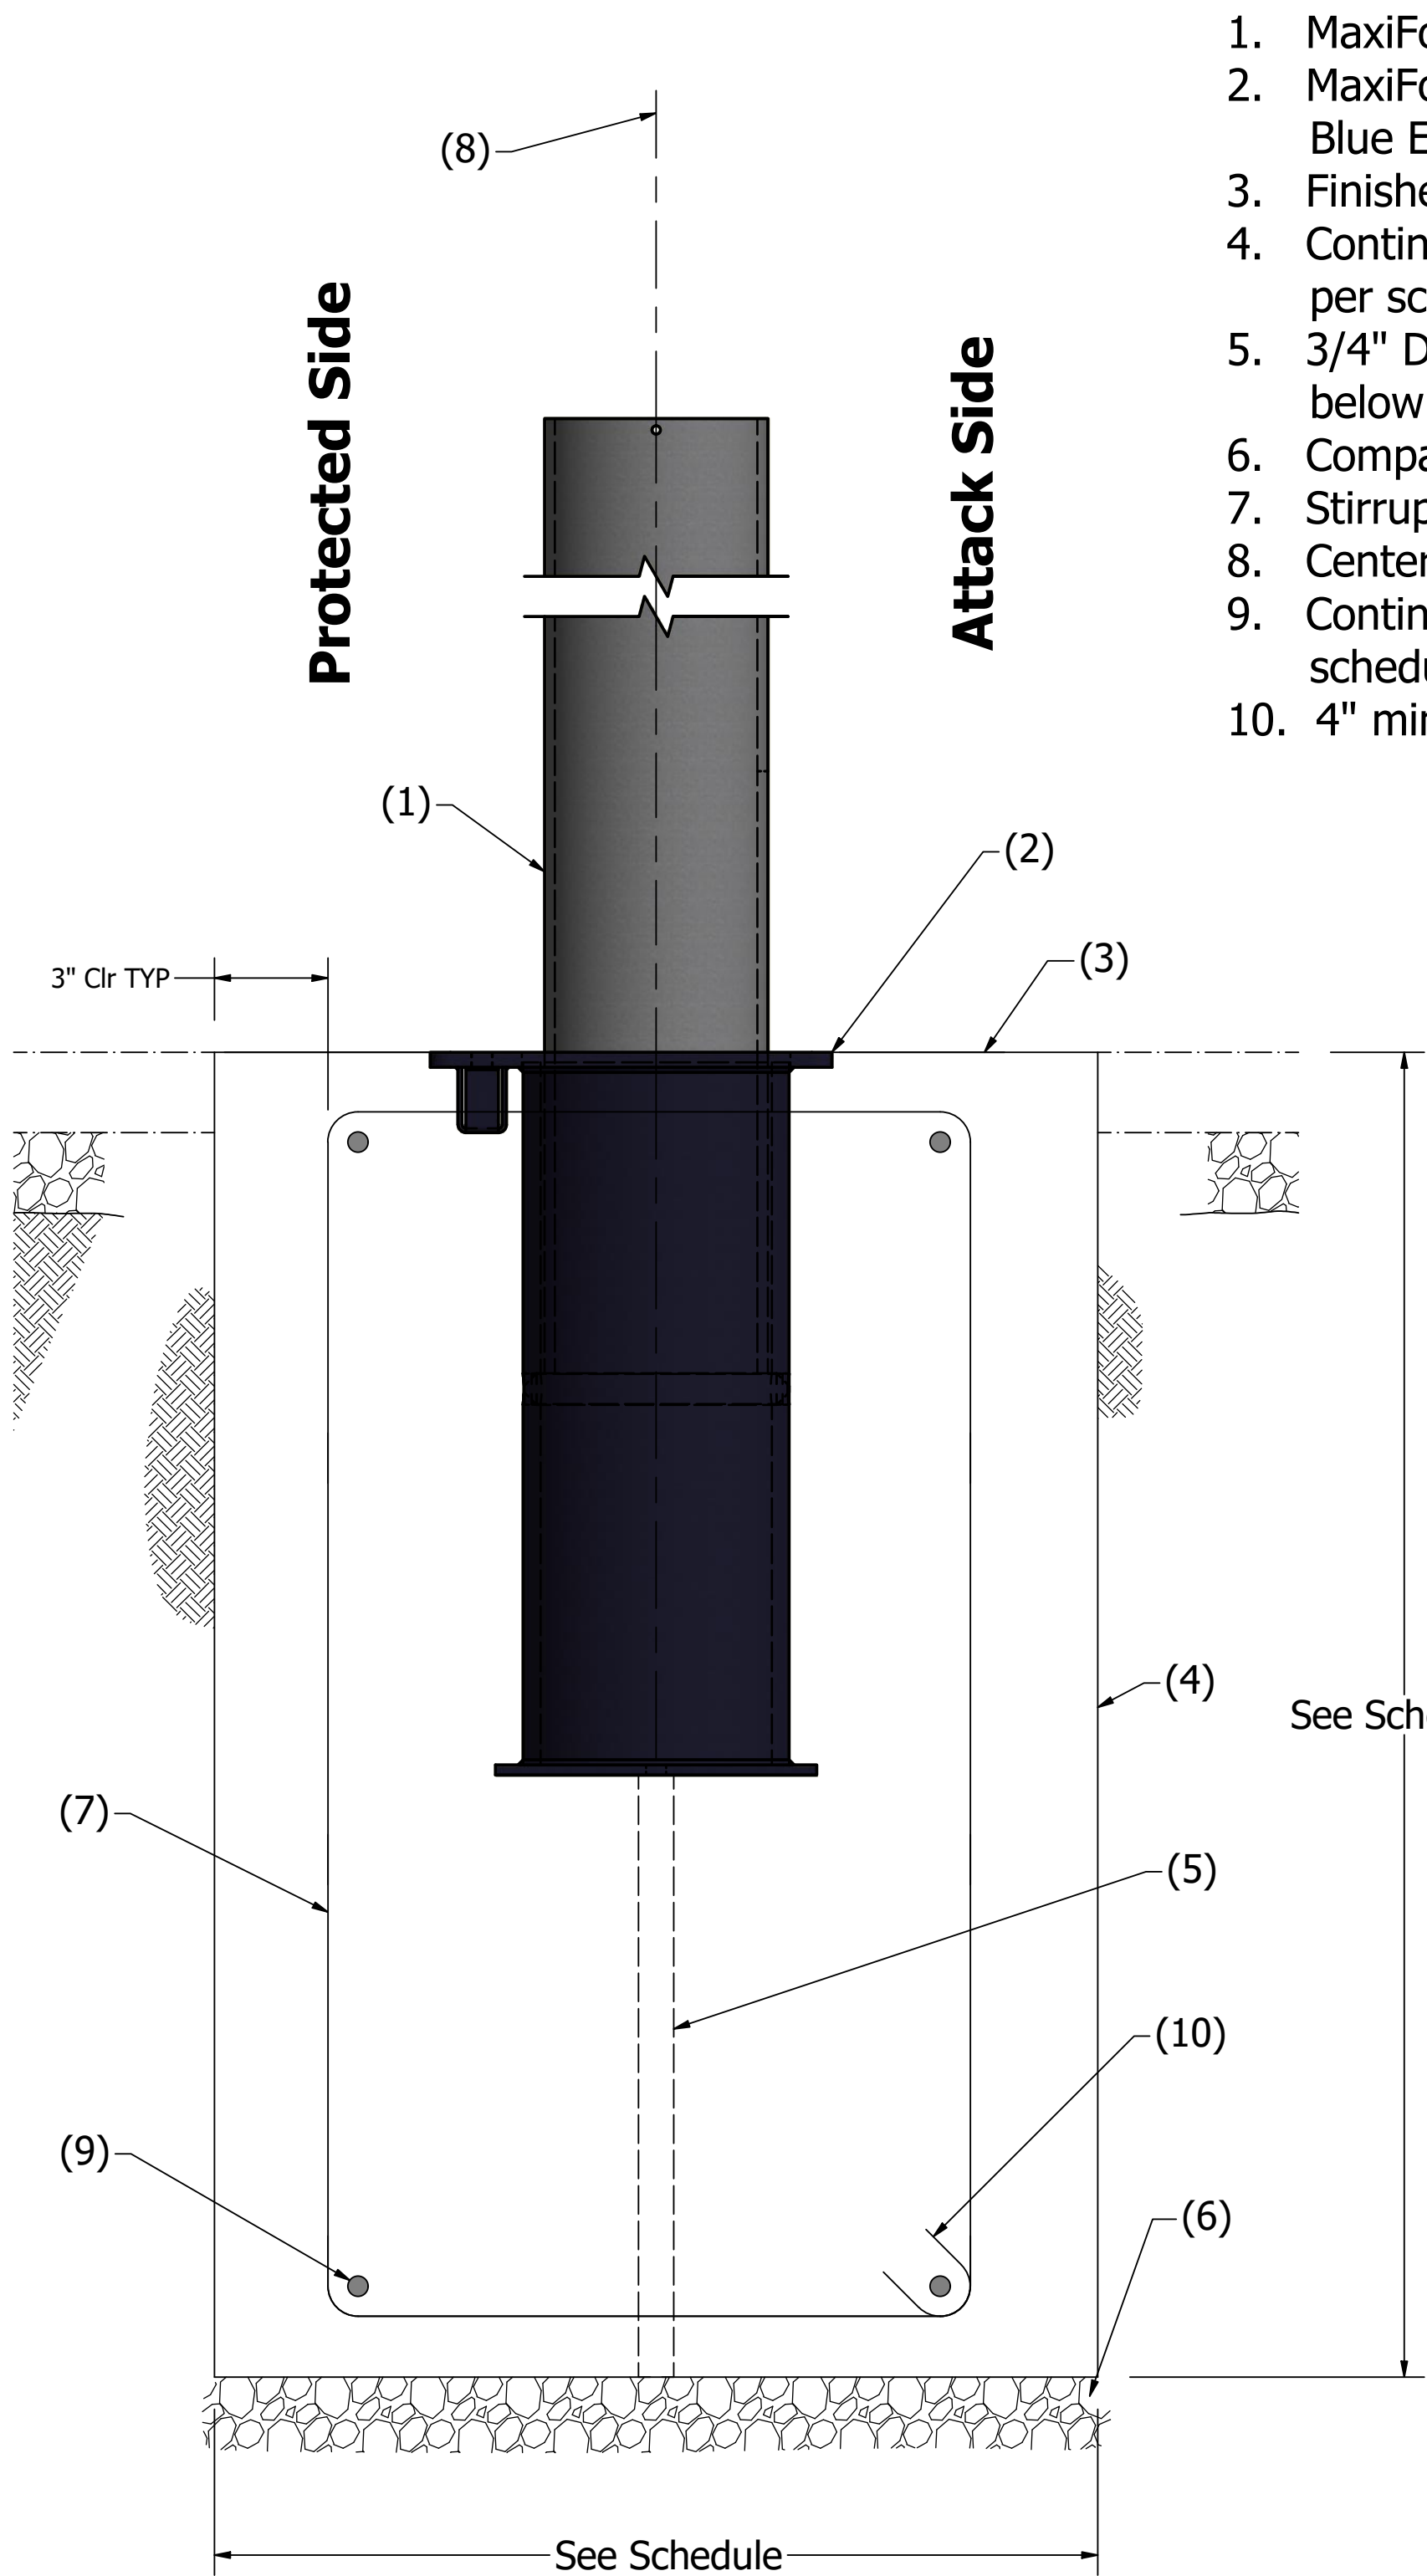

1. MaxiForce Steel pipe bollard per specification.
2. MaxiForce HD or HDH Base assembly per Blue Ember Technologies.
3. Finished grade or pavement.
4. Continuous concrete grade beam per schedule.
5. 3/4" Dia. PVC pipe as needed for drainage below pipe sleeve.
6. Compacted gravel bed (3" minimum).
7. Stirrups per schedule.
8. Centerline of bollard and concrete grade beam.
9. Continuous longitudinal reinforcement per schedule - lap splice 32" min. for #4 rebar.
10. 4" min. hooks with 135 degree bend - TYP. UNO.

Installation Orientation

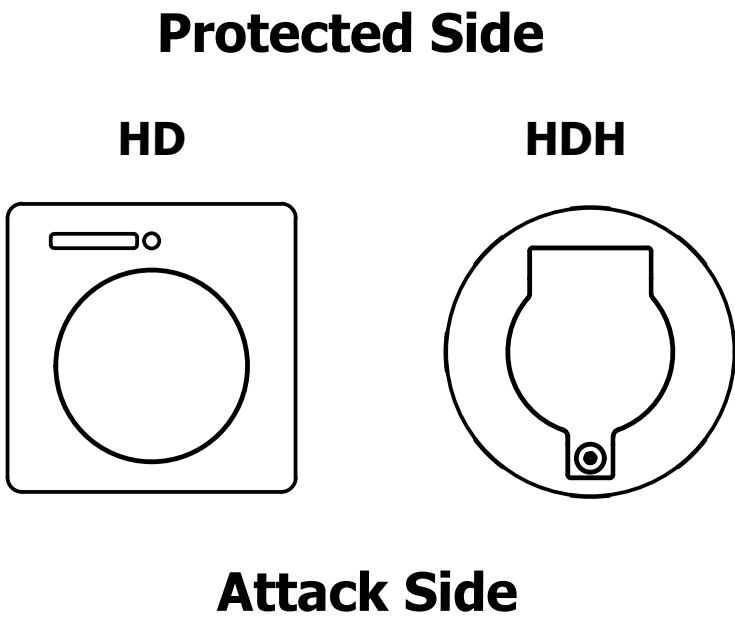

| | | | |
|---|-----------------------|--|----------------------|
| Drawing Rev. 1 | Created 11/18/2020 | <div>MaxiForce</div> <div>7560 Main Street Sykesville, MD 21784 tel: +1 (410) 552 9888 sales@maxiforcebollards.com www.maxiforcebollards.com</div> <div><div>MaxiForce Bollards</div></div> | |
| <div>PROPRIETARY AND CONFIDENTIAL</div> <div>THIS DRAWING CONTAINS PROPRIETARY INFORMATION OF BLUE EMBER TECHNOLOGIES, LLC. ANY USE OF THIS DRAWING OR THE INFORMATION CONTAINED HEREIN FOR OTHER THAN THE PURPOSE FOR WHICH THIS DRAWING IS FURNISHED IS FORBIDDEN.</div> | | Title HD/HDH Base Beam Footing | |
| | | C | DO NOT SCALE DRAWING |